

Lafferty Equipment Manufacturing, Inc. Installation & Operation Instructions

Model # 919045 · FPS Fogger Chemical Feed System

REQUIREMENTS / SPECIFICATIONS

Chemical Concentrate or RTU Solution

| | |
|-----------------------|--------------------------------|
| Compressed Air | up to 4 CFM |
| 80 PSI air in | 20 PSI solution out @ 4.25 GPM |
| 60 PSI air in | 20 PSI solution out @ 3.5 GPM |

OPTIONS

Alternate Air Pump Diaphragm - Santoprene Standard

| | |
|--|----------|
| Viton Diaphragm Upgrade For Flojet Air Pump | # 710756 |
| Kalrez Diaphragm Upgrade For Flojet Air Pump | # 710755 |


Electronic Zone Control

| | |
|--|----------|
| 3-Zone PF Fogger PLC Vision Controller | # 950843 |
| 6-Zone PF Fogger PLC Vision Controller | # 950846 |
| Zone Control Kit | # 950850 |
| Metered Bleed Assembly | # 950852 |

WEIGHT & DIMENSIONS

Single Package

| | |
|---------------------|-----------------|
| Shipping Weight | 20 lbs. |
| Shipping Dimensions | 15" x 15" x 11" |

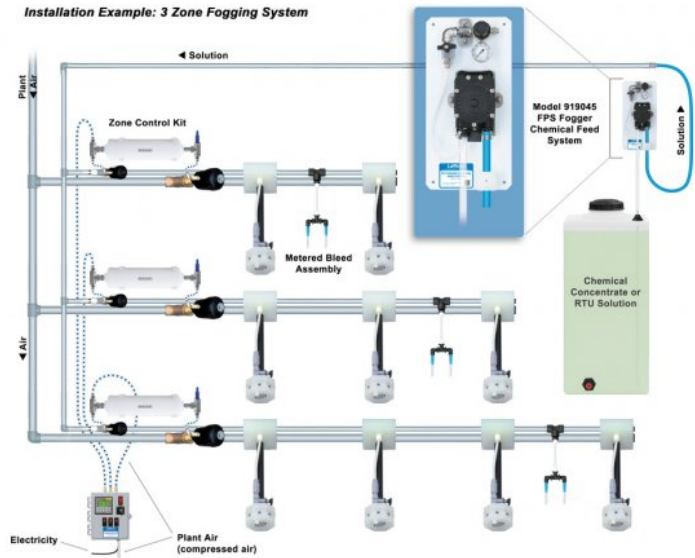

Lafferty
EQUIPMENT MANUFACTURING INC.

www.laffertyequipment.com

501-851-2820

**WARNING! READ ALL
INSTRUCTIONS BEFORE
USING EQUIPMENT!**



OVERVIEW

The FPS Fogger Chemical Feed System is a compressed air driven system that will deliver neat or pre-diluted chemical solution to Pump Fed Foggers at the appropriate pressure.

SAFETY & OPERATIONAL PRECAUTIONS

- For proper performance do NOT modify or substitute hose diameter.
- Manufacturer assumes no liability for the use or misuse of this unit.
- Wear protective clothing, gloves and eye-wear when working with chemicals.
- Always direct the discharge away from people and electrical devices.
- Follow the chemical manufacturer's safe handling instructions.
- DO NOT use d-Limonene or other chemicals that are not compatible with the Santoprene diaphragms.
- Viton or Kalrez upgrades are available.


TO INSTALL (REFER TO DIAGRAM ON NEXT PAGE)

1. Mount the unit above solution supply level to prevent siphoning.
2. Place the strainer in the chemical solution(s).
3. Attach the discharge hose.
4. Attach a compressed airline to the air inlet ball valve. DO NOT TURN ON.
5. Air Filter/Dryer recommend.

TO OPERATE

You are now ready to operate the system, depending on the intended application.

1. Turn the inlet ball valve slightly until the pump primes then open fully to begin pumping.

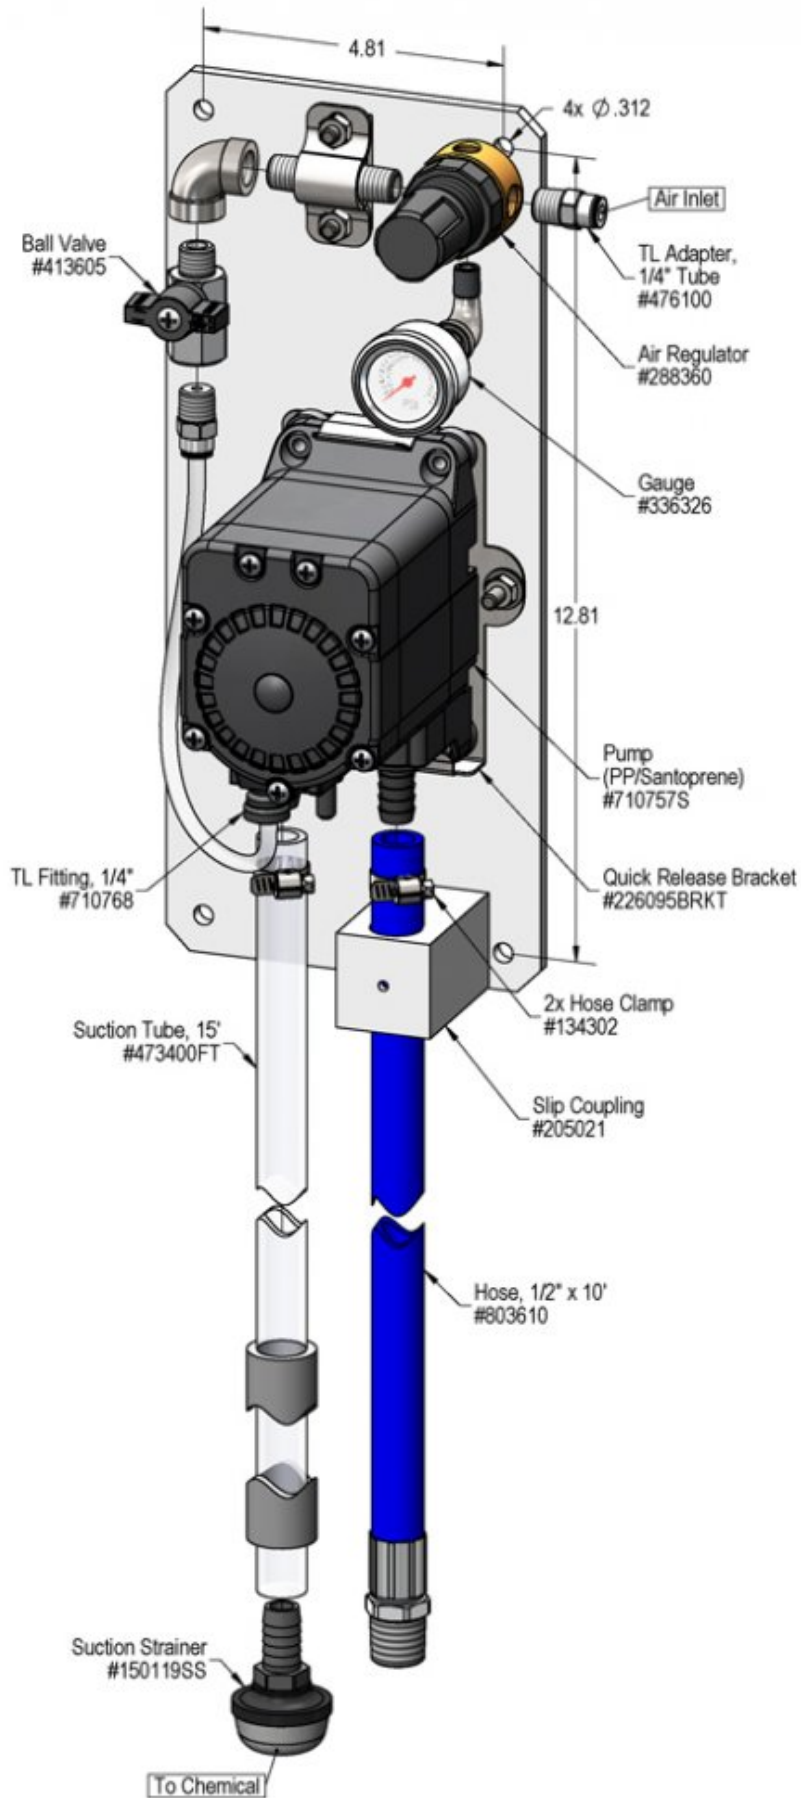

Troubleshooting Guide

| Problem | Possible Cause / Solution | |
|---|---------------------------|-------------|
| | Startup | Maintenance |
| A) Air pump will not run or pump chemical solution. | 1,3,4 | 5,6,9,10 |
| B) Will not draw chemical. | 1,2,3 | 6,7,8 |
| C) Pump runs too fast with no output. | 2 | 6,7,8,9 |

| Possible Cause / Solution | |
|---|---|
| Startup | Maintenance |
| <ol style="list-style-type: none"> 1. Inlet ball valve partially closed or air pressure too low. <ul style="list-style-type: none"> ◦ Completely open air inlet ball valve. 2. Chemical tube not immersed in container or container empty <ul style="list-style-type: none"> ◦ Immerse tube or replenish. 3. Hose kinked <ul style="list-style-type: none"> ◦ Straighten the hose. 4. Ice particles from condensation in air line — Air pump can periodically "freeze up" (stall) due to ice particles in the pump's exhaust (depending on air humidity & other factors) <ul style="list-style-type: none"> ◦ WAIT several seconds to allow the ice particles to melt and blow out, at which time the pump will automatically resume pumping. | <ol style="list-style-type: none"> 5. Air regulator clogged or failed <ul style="list-style-type: none"> ◦ Clean or replace. 6. Chemical strainer clogged up <ul style="list-style-type: none"> ◦ Clean or replace. 7. Vacuum leak in suction line. <ul style="list-style-type: none"> ◦ Tighten the connection(s). 8. Chemical tube stretched out where tube attaches or pin hole/cut in tube sucking air. <ul style="list-style-type: none"> ◦ Cut off end of tube or replace tube. 9. Problem with air pump <ul style="list-style-type: none"> ◦ Refer to air pump instruction manual. ◦ https://www.xylem.com/en-us/brands/Flojet/flojet-products/g57-air-operated-double-diaphragm-pump ◦ Replace pump. 10. Use of an oiler in the airline will cause pump to stall <ul style="list-style-type: none"> ◦ Use only clean, dry air. |

PREVENTIVE MAINTENANCE: When the unit will be out of service for extended periods, place chemical tube(s) in water and flush the chemical out of the unit to help prevent chemical from drying out and causing build-up. Periodically check and clean chemical strainer and replace if missing.

